



CENTRUM STAVEBNÍHO INŽENÝRSTVÍ a. s.
CENTRE OF BUILDING CONSTRUCTION ENGINEERING plc.
workplace Zlín, K Cihelně 304, 764 32 Zlín - Louky

Testing laboratory of physical properties of materials, structures and buildings – Zlín, Testing laboratory No. 1007.1, accredited by the CAI



Test Report No. 134/15

**Laboratory Measurement of Airborne and of Impact Sound Insulation
according to ČSN EN ISO 10140-2, ČSN EN ISO 10140-3**

Test subject: Wooden ceiling panels with filling

Contract No: 563 339

Number of pages: 8

Number of copies: 2

Copy No.: 1e

Customer: **AGROP NOVA a.s.**
Ptenský Dvorek 99
798 43 Ptení
Czech Republic

Sample accepted on: 01.04.2015

Tested on: 01.04.2015

Tested by the Building Acoustics Laboratory

Technical head of laboratory: Ing. Miroslav Figalla

Head of testing laboratory No. 1007.1:

Ing. Miroslav Figalla

The Accredited Testing Laboratory hereby declares that test results cover the tested object only and does not imply approval or certification of the tested product. Without a written consent by the Testing Laboratory, the Test Report may not be reproduced otherwise than in full.

Date: 10.04.2015



tel.: +420 577 604 168, +420 577 604 164, +420 577 604 111, tel./fax: +420 577 604 348
fax: +420 577 104 926, e-mail: miroslav.figalla@csizlin.cz, www.csias.cz, www.csizlin.cz

1. Assignment

The test was carried out based on the order, contract No. 563 339.

2. Subject of Test

To perform laboratory measurement of airborne sound insulation and impact sound insulation in accordance with standards ČSN EN ISO 10140-2, ČSN EN ISO 10140-3.

Element tested: Wooden ceiling panels with limestone filling. NOVATOP ELEMENT panels are large ribbed components made of multi-layer solid panels. The structure of the element is composed of a bearing bottom multi-layer panel, whose thickness depends on the required fire resistance of the construction. Transverse and longitudinal ribs, whose height depends on the bearing capacity of the element, are glued to it. The whole structure is enclosed with a top multi-layer panel. Cavities are infilled with limestone grit. Drawings of ceiling are shown on pages 7 and 8.

3. Test Sample

The Customer provided material for the ceiling construction on 01.04.2015. The ceiling of dimensions 3600 mm x 3000 mm has been assembled from two elements, in the test hole for horizontal constructions. Lateral seams along the ceiling circumference have been sealed with textile cord and rubber profile. Assembly of the floor has been performed together by the Customer and laboratory staff.

4. Standards used and measuring equipment

4.1 Standards

- ČSN EN ISO 10140-1 Acoustics. Laboratory measurement of sound insulation of building elements. Part 1: Application rules for specific products,
- ČSN EN ISO 10140-2 Acoustics. Laboratory measurement of sound insulation of building elements. Part 2: Measurement of airborne sound insulation,
- ČSN EN ISO 10140-3 Acoustics. Laboratory measurement of sound insulation of building elements. Part 3: Measurement of impact sound insulation,
- ČSN EN ISO 10140-4 Acoustics. Laboratory measurement of sound insulation of building elements. Part 4: Measurement procedures and requirements,
- ČSN EN ISO 717-1 Acoustics. Rating of sound insulation in buildings and of building elements. Airborne sound insulation.
- ČSN EN ISO 717-2 Acoustics. Rating of sound insulation in buildings and of building elements. Part 2: Impact sound insulation.

Related standards:

- ČSN EN ISO 10140-5 Acoustics. Laboratory measurement of sound insulation of building elements. Part 5: Requirements for test facilities and equipment,
- ČSN EN 20140-2 Acoustics – Measurement of sound insulation in buildings and of building elements. Part 2: Determination, verification and application of precision data.

4.2 Measuring equipment

- | | |
|--------------------------------|-----------|
| - Norsonic RTA 840 analyzer | M 07 2024 |
| - B. K. measuring microphone | M 07 2005 |
| - acoustic calibrator B.K. | M 07 2015 |
| - tapping machine B.K. | I 10 780 |
| - power amplifier AM-39 | I 05160 |
| - omnidirectional sound source | I 52346 |

5. Testing Procedure

5.1 Airborne sound insulation

Measuring is performed in sound chambers meeting the requirements of the ČSN ISO 10140-5 standard. The tested element is mounted between the source and receiving room into a measuring opening for horizontal elements. A steady sound is generated in the source room with continuous spectrum in the 100 to 5000 Hz band. Mean sound levels of acoustic pressure are measured in the source and receiving room (in dB). Sound reduction index is determined by the relations

$$R = L_1 - L_2 + 10 \log \frac{S}{A} \quad (\text{dB}), \quad A = \frac{0,16 V}{T} \quad (\text{m}^2)$$

where L_1 is the average sound pressure level in the source room,
 L_2 .. average sound pressure level in the receiving room,
 S ... area of the test sample in m^2 ,
 A ... equivalent absorption area in the receiving room in m^2 ,
 V ... is the volume of the receiving room in m^3 ,
 T ... reverberation time in the receiving room in seconds

A single-number quantity, weighted sound reduction index R_w , and spectrum adaptation terms C , C_{tr} , are determined from the values of sound reduction index R in third-octave bands 100 to 3150 Hz, using the reference curve and method according to ČSN EN ISO 717-1.

5.2 Impact Sound Insulation

A normalised impact source is placed on the measured floor. Mean levels of acoustic pressure in the receiving room (lower room) in individual third octave bands in the range of 100 (50) to 5000 Hz are measured. A normalized impact sound level L_n is calculated using the following equation

$$L_n = L_i + 10 \log \frac{A}{A_0} \quad (\text{dB}),$$

where L_i is a mean level of acoustic pressure in the receiving room,
 A ... equivalent absorption area in the receiving room in m^2 ,
 A_0 .. reference value, $A_0 = 10 \text{ m}^2$.

A single-number quantity, weighted normalized impact sound level $L_{n,w}$, and spectrum adaptation term C_i , are determined from the values of normalized impact sound level L_n in third-octave bands 100 to 3150 Hz, using the reference curve and method according to ČSN EN ISO 717-2.

6. Test Results

Reg. No.	Description of the ceiling	Airborne Sound Insulation Impact Sound Insulation
82/15 81/15	Wooden ceiling panels with filling	$R_w (C; C_{tr}) = 37 (0; -1) \text{ dB}$ $L_{n,w} (C_i) = 86 (1) \text{ dB}$

The courses of sound reduction index and normalized impact sound pressure level depend on the frequency and further measurement data are shown in standard measuring records on pages 5 - 6.

7. Measurement Uncertainty

Measurement uncertainty is to be expressed in accordance with ČSN EN 20140-2 using the indices of repeatability r and reproducibility R that are the values under which the absolute value of the difference of the results of tests performed under specified conditions will lie with the probability of 95 %. For a single-number quantities R_w , L_{nw} , the repeatability index $r = 1$ dB, the reproducibility index $R = 2$ dB.

In charge for the test: Ing. Miroslav Figalla

Note:

This document is a translation of the Test Report No. 134/15 dated 10.04.2015. In case of ambiguity or doubts, the Czech version prevails.

Sound reduction index in accordance to EN ISO 10140-2
Laboratory measurement of airborne sound insulation of building elements

Reg. No.:
82/15

Customer:
AGROP NOVA a.s.
Ptenský Dvorek 99
798 43 Ptení
Czech Republic

Product: Wooden ceiling without floor

Composition of the structure:

- top panel NOVATOP ELEMENTS thickness of 27 mm,
 - transversal and longitudinal ribs 180 mm + limestone grit 80 kg/m²,
 - bottom panel NOVATOP ELEMENTS thickness of 33 mm,
- Dimensions of the ceiling 3600 mm x 3000 mm, thickness 240 mm, surface weight 122 kg/m².


Conditions of the test

Area of test element: 10 m²
Source room volume: 90 m³
Receiving room volume: 75 m³

Test date: 01.04.2015
Air temperature: 19 °C
Relative humidity: 46 %
Static pressure: 977 hPa

Freq. (Hz)	R 1/3 okt. (dB)
50	27,4
63	40,7
80	41,6
100	36,2
125	37,2
160	34,3
200	34,9
250	37,1
315	36,5
400	34,2
500	33,2
630	34,3
800	35,1
1000	35,2
1250	36,4
1600	36,6
2000	38,4
2500	40,4
3150	41,8
4000	43,4
5000	46,2
Rating according EN ISO 717-1	
R_w (C; C_{tr}) = 37 (0; -1) dB	

C₅₀₋₃₁₅₀ = 0 dB, C_{tr,50-3150} = -1 dB
C₅₀₋₅₀₀₀ = 0 dB, C_{tr,50-5000} = -1 dB
C₁₀₀₋₅₀₀₀ = 0 dB, C_{tr,100-5000} = -1 dB

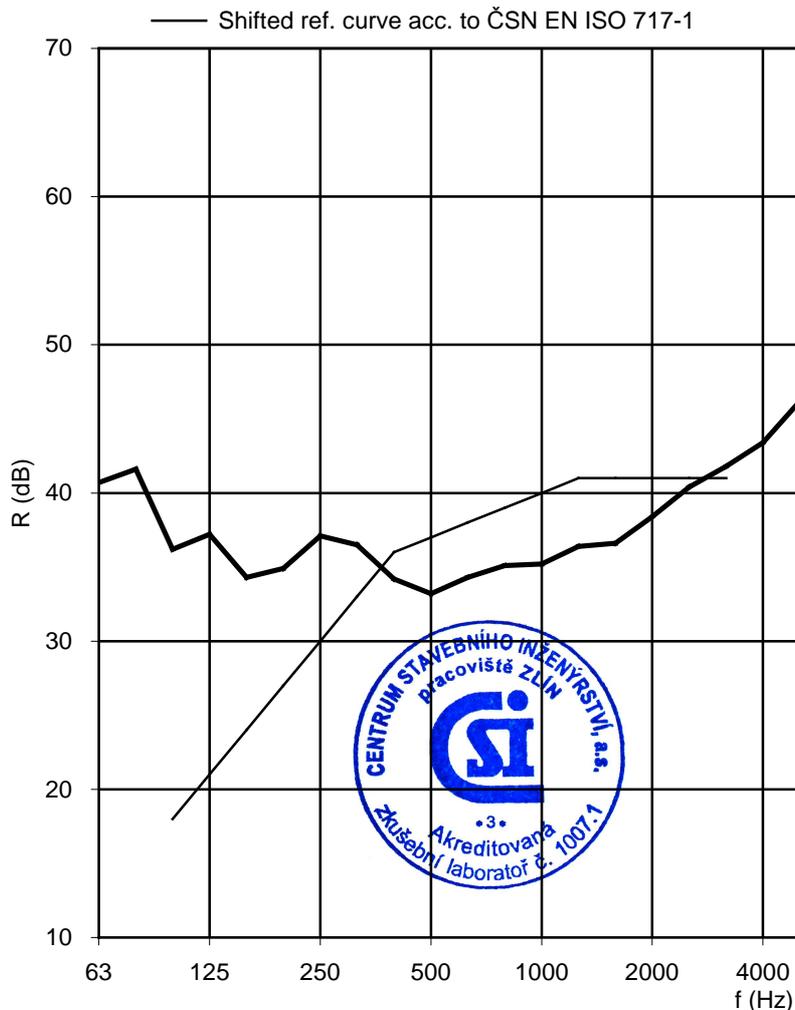

Centrum stavebního inženýrství a.s.
pracoviště Zlín

Date: 10.04.2015

Ing. Miroslav Figalla
Head of laboratory

Normalized impact sound pressure level in accordance with ISO 10140-3

Reg. No.:

Laboratory measurements of impact sound insulation of floors

81/15

Customer:
AGROP NOVA a.s.
Ptenský Dvorek 99
798 43 Ptení
Czech Republic

Product: Wooden ceiling without
floor

Composition of the structure:

- top panel NOVATOP ELEMENTS thickness of 27 mm,
 - transversal and longitudinal ribs 180 mm + limestone grit 80 kg/m²,
 - bottom panel NOVATOP ELEMENTS thickness of 33 mm,
- Dimensions of the ceiling 3600 mm x 3000 mm, thickness 240 mm, surface weight 122 kg/m².

Conditions of the test

Area of test element: 10 m²
Source room volume: 90 m³
Receiving room volume: 75 m³


Test date: 01.04.2015

Air temperature: 19 °C
Relative humidity: 46 %
Static pressure: 977 hPa

Freq. (Hz)	L_n 1/3 okt. (dB)
50	66,9
63	53,3
80	61,7
100	62,3
125	68,8
160	70,1
200	75,3
250	78,7
315	83,2
400	85,6
500	86,3
630	87,6
800	87,3
1000	87,0
1250	84,2
1600	80,8
2000	76,4
2500	73,5
3150	70,8
4000	66,4
5000	61,4

Rating according EN ISO 717-2
 $L_{n,w}(C_1) = 86 (-6) \text{ dB}$

$C_{1,50-2500} = -6 \text{ dB}$

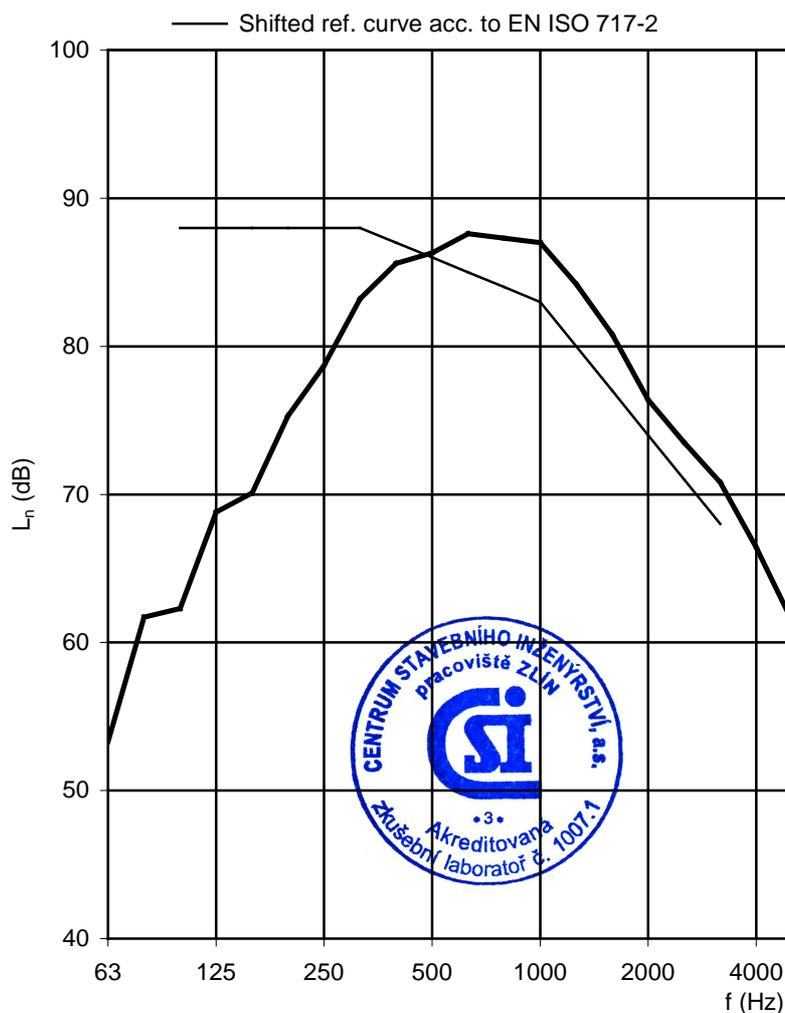


Centrum stavebního inženýrství a.s.
pracoviště Zlín


Date: 10.04.2015

Ing. Miroslav Figalla
Head of laboratory

Composition of the Floor I.

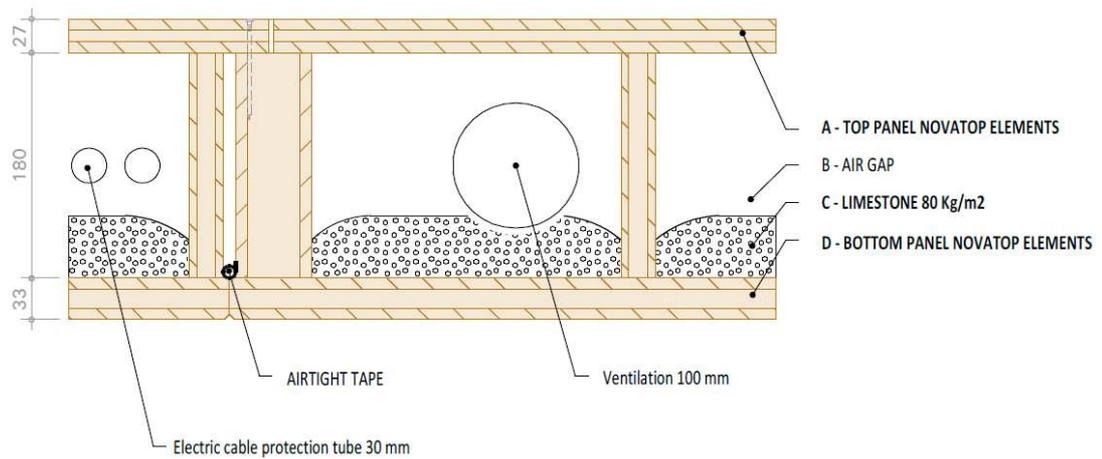

NOVATOP 	AGROP 	Řez A-A	
		AGROP NOVA a.s. Ptenský Dvůrek 99 798 43 Ptení Česká republika	
Vojtěch Jemelík Composition of the Floor I.			

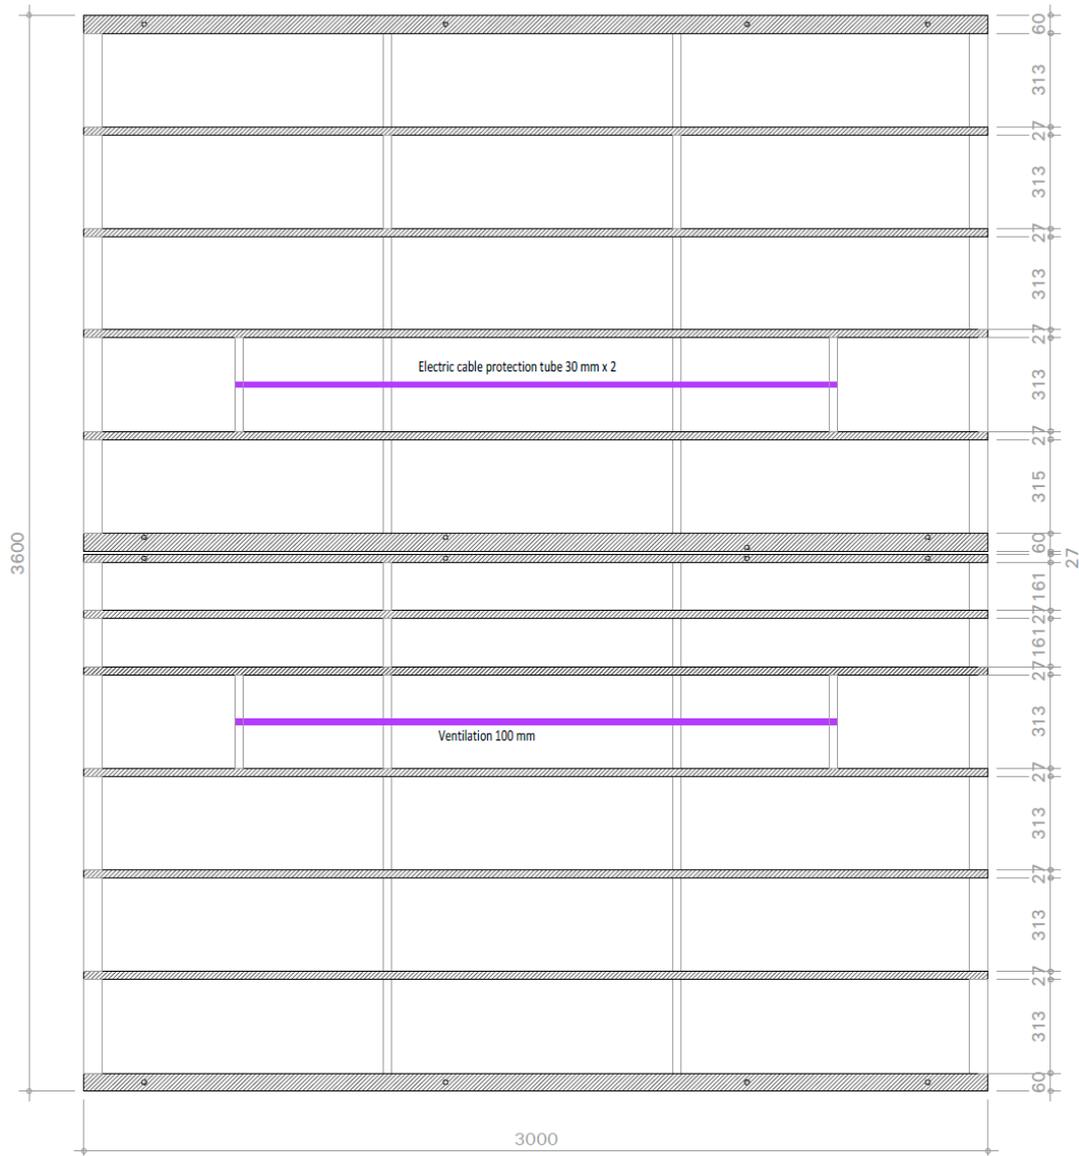

NOVATOP  **AGROP** 

Vojtěch Jemelík
Geschossdecke

Řez A-A
Řez B-B

AGROP NOVA a.s.
Přemyslovská 99
798 43 Píseň
Česká republika

